

PACSystems* RX3i

IC695CHS012 and IC695CHS016


Universal Backplanes

GFK-2554A
March 2012

The PACSystems* RX3i Universal Backplanes provide a dual-bus backplane that supports PCI-based (IC695) and serial (IC693 and IC694) I/O and option modules. The RX3i Universal Backplanes also support Series 90-30 IO and option modules. See the *PACSystems RX3i System Manual*, GFK-2314 for lists of supported modules. The 16-slot Universal Backplane (IC695CHS016), and the 12-slot Universal Backplane (IC695CHS012) include the following features:

- Terminal Strip on the left end for Isolated +24V input
- Backplane grounding point
- An integral grounding bar for connecting module/shield grounds
- Serial Expansion connector for connection to Serial Expansion and Remote Backplanes
- Slot numbers printed on the backplane that can be used as a reference for configuration.

The 12-slot Universal Backplane (IC695CHS012) is illustrated below.

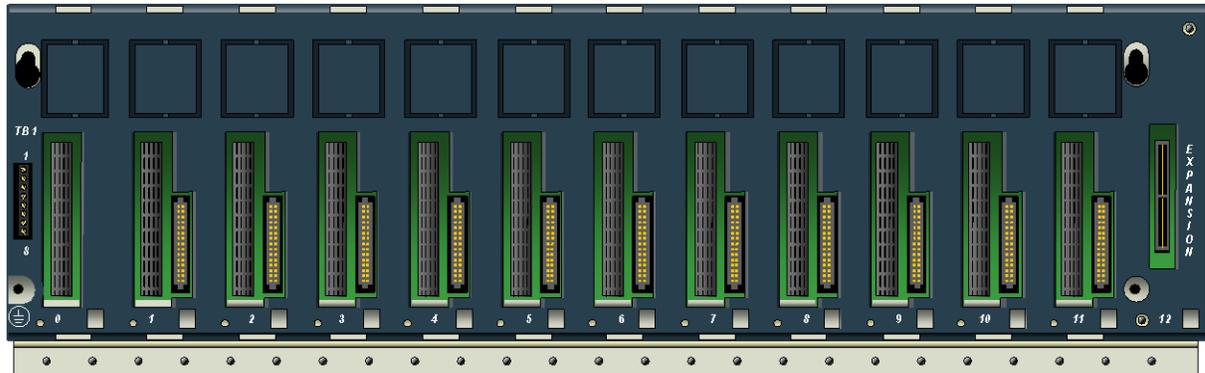

Release History

Catalog Number	Date	Description
IC695CHS012 / 016-DA	March 2012	Mechanical enhancements for improved module-to-connector engagement with the backplane PCI connector. For details, see "New Features and Enhancements in this Release" on page 6.
IC695CHS012 / 016-CA	April 2009	Hardware changes for EU-RoHS compliance
IC695CHS012 / 016-BAMP	February 2009	Improved immunity against environmental noise
IC695CHS012 / 016-BA	September 2007	ATEX approval for Group 2, Category 3 applications.
IC695CHS012 / 016A	August 2004	Initial product release

* indicates a trademark of GE Intelligent Platforms, Inc. and/or its affiliates. All other trademarks are the property of their respective owners. All rights reserved.

UL Class 1 Division 2 & ATEX Zone 2 Hazardous Area Warnings

1. EQUIPMENT LABELED WITH REFERENCE TO CLASS I, GROUPS A, B, C, D, DIV. 2 HAZARDOUS AREAS IS SUITABLE FOR USE IN CLASS I, DIVISION 2, GROUPS A, B, C, D OR NON-HAZARDOUS LOCATIONS ONLY.
2. WARNING – EXPLOSION HAZARD – SUBSTITUTION OF COMPONENTS MAY IMPAIR SUITABILITY FOR CLASS I, DIVISION 2 & ATEX ZONE 2.
3. WARNING – EXPLOSION HAZARD – DO NOT DISCONNECT EQUIPMENT UNLESS POWER HAS BEEN SWITCHED OFF OR THE AREA IS KNOWN TO BE NON-HAZARDOUS.

ATEX Zone 2 Hazardous Area Requirements

In order to maintain compliance with the ATEX Directive, an RX3i system located in a Zone 2 area (Category 3) must be installed within a protective enclosure meeting the criteria detailed below:


- IP54 or greater, and
- Mechanical strength to withstand an impact energy of 3.5 Joules

RX3i Universal Backplane Installation



The RX3i system and its components are considered open equipment (having live electrical parts that may be accessible to users) and must be installed in a protective enclosure or incorporated into other assemblies manufactured to provide safety. As a minimum, the enclosure or assemblies must provide protection equivalent to a NEMA/UL Type 1 enclosure or an IP20 rating (IEC60529). The enclosure must be able to adequately dissipate the heat generated by all of the components mounted inside so that no components overheat. A minimum space of at least 102mm (4 inches) as shown below is required on all sides of the RX3i backplane for cooling. Additional space may be required, depending on the amount of heat generated by the equipment during operation. Please refer to the *PACSystems RX3i System Manual*, GFK-2314, for information about enclosures and heat dissipation.

Backplane Orientation

Backplanes must be mounted horizontally to meet product performance and reliability specifications by providing adequate airflow around the modules. Other mounting orientations may affect system performance and/or reliability and are therefore not recommended.

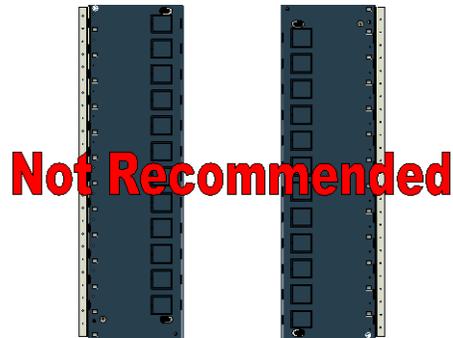

Backplane Dimensions and Spacing

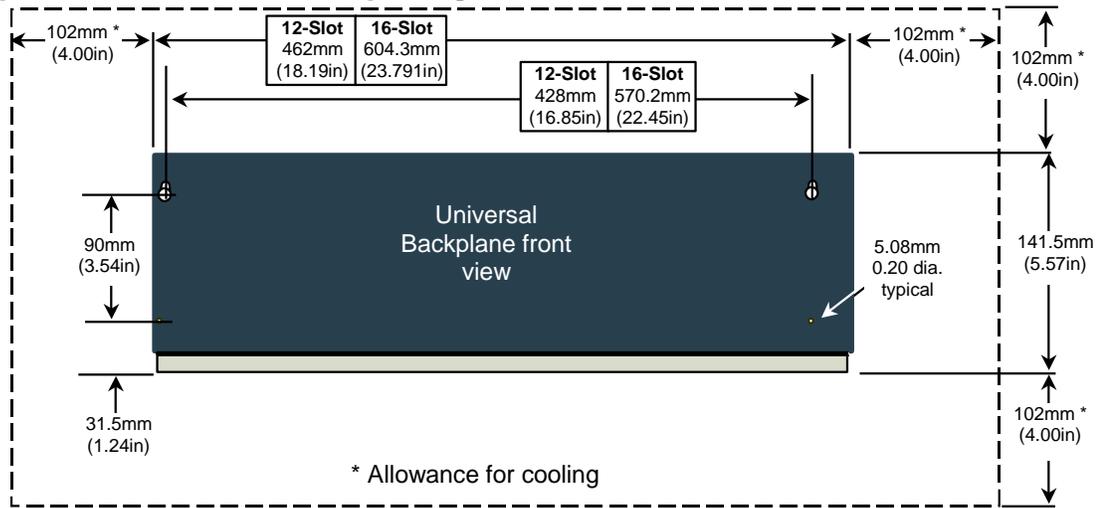

Side dimension is for standard modules with doors closed.

Side dimension does not include extra depth required for cables and connectors.

Modules with Extended High-Density Terminal Blocks (such as Terminal Block IC694TBB132) are approximately 1/2-inch (13mm) deeper overall.

GFK-2554A

RX3i Universal Backplane Terminals and Connectors


TB1 Input Terminals

The RX3i IC695 Power Supplies do not provide Isolated +24V output power over the backplane. TB1 input terminals 7 and 8 can be used to connect an optional external source of Isolated +24VDC, which is required for some IC693 and IC694 modules. These terminals accept individual wires from 14 to 22 AWG. If modules that require Isolated +24VDC are installed in an Expansion Backplane instead, an external Isolated +24V power supply is not required.

TB1 terminals 1 through 6 are not used.

Slot 0

The leftmost slot in a Universal Backplane is slot 0. Only the backplane connector of IC695 Power Supplies can be installed in slot 0 (note: IC695 Power Supplies can be installed any slot).

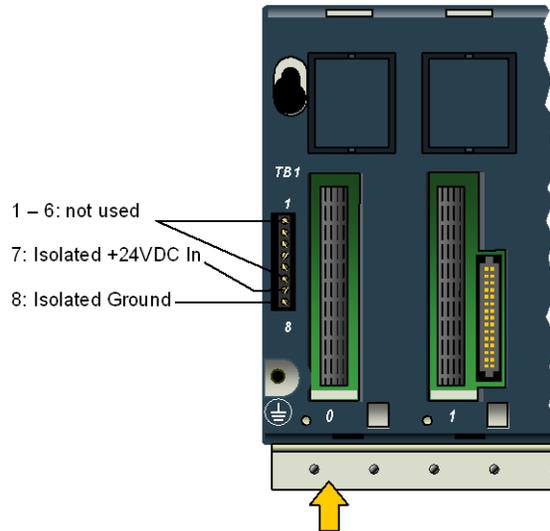


Slot 0: Connector for RX3i IC695 Power Supply only

Two-slot-wide modules that have right-justified connectors, like the CPU310, can be plugged into slot 1 and also cover slot 0. The CPU is referenced for configuration and application logic by the leftmost slot occupied by the entire module, not by the slot the physical connector is located in. For example, if the CPU has its physical connector inserted in slot 3, the module occupies slots 2 and 3 and the CPU is considered to be located in slot 2. The CPU may be located in slot 0 with its connector in slot 1.

Slot 1 to Slot 11 or 15

Slots 1 through 11 or 15 have two connectors: a connector for the RX3i PCI-based bus and a connector for the RX3i serial bus. Each of these slots can accept any type of compatible module: IC695 Power Supply, IC695 CPU, or IC695, IC694 and IC693 I/O or option modules. See the *PACSystems RX3i System Manual*, GFK-2314 for lists of supported modules.

Provided the Hot Installation procedure described in the *PACSystems RX3i System Manual*, GFK2314, is carefully followed, I/O and option modules in a Universal Backplane may be removed and replaced without powering-down.

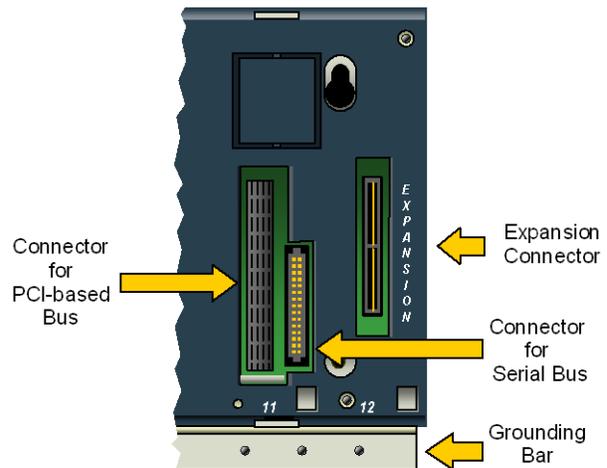

Expansion Slot (Slot 12 or 16)

The rightmost slot in a Universal Backplane is the expansion connector. It can only be used for an RX3i Serial Expansion Module (IC695LRE001). An RX3i two-slot module cannot occupy this expansion slot.

Grounding Bar

Module shield grounds can be connected to the Grounding Bar at the bottom of a Universal Backplane using size M3 screws. The recommended torque is 4 in/lb maximum.